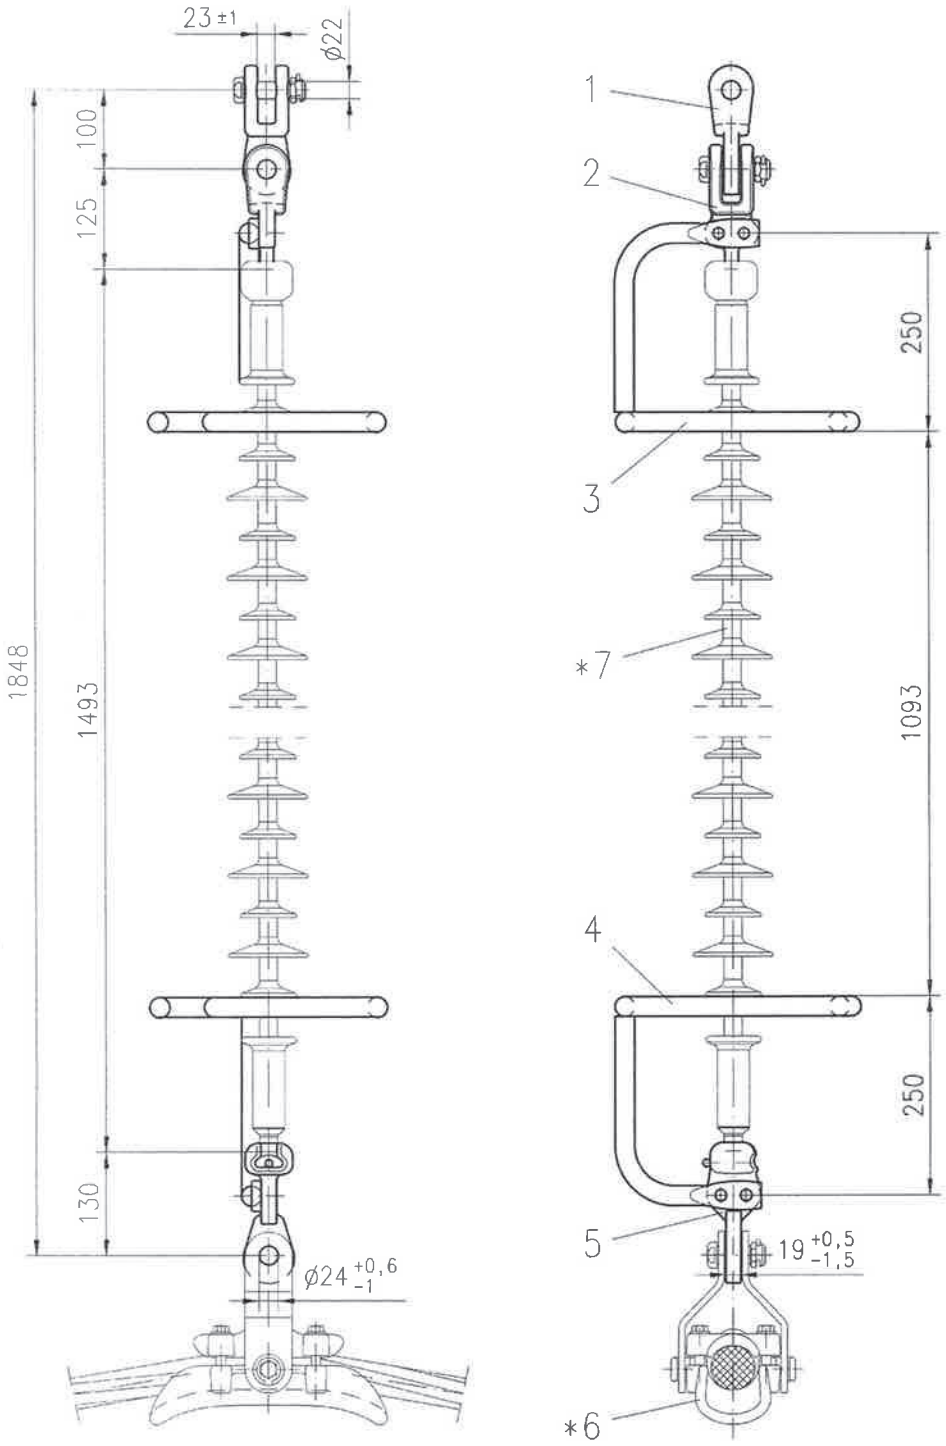

* (Insulator, Suspension clamp will be ordered seperately)

Itm	Qty	Description	Standard	Drg. no.	Art. no.	Material	Surface	Mass [kg]
*7	1	Insulator	IEC 16					
*6	1	Suspension clamp						
5	1	Socket eye twisted	IEC 16	F0308029	4220.301/4			
4	1	Lower arcing ring		F0711646/2	4760.42/2/2			
3	1	Upper arcing ring		F0711392/2	4760.42/3			
2	1	Ball clevis twisted	IEC 16	F0305021	4217.32/1			
1	1	Clevis eye twisted		F0311067	4265.76			

2014	Date	Name	MOSDORFER KNILL GRUPPE
Drawn	03.06.	Grimm	
Checked	03.06.	Schinnerl	

Replace for
Replaced by
Art. No.
Sim. to drg.-no. HS11E0218

Scale NTS

Title: 145 kV Single Susp. Set

Drg. No. HS11E0430

Rev. | Mod. | A3

No. of pages | Page

Tolerance acc. to: ---- | Short circuit current: 40 kA 1s | Breaking load: 120 kN | Mass: --- kg

Letter | Revision | Date | Name | Number | Modification | Date | Name

This page and its indications is intellectual property of Mosdorfer Company and it "sn" o loaned to forward those information to c 'h rd par'y; w thout the writter assent of Mosdorfer Company